THIS PRINT IS PROVIDED ON A RESTRICTED BASIS AND IS NOT TO BE USED IN ANY WAY DETERMINAL TO THE INTEREST OF HALSANG

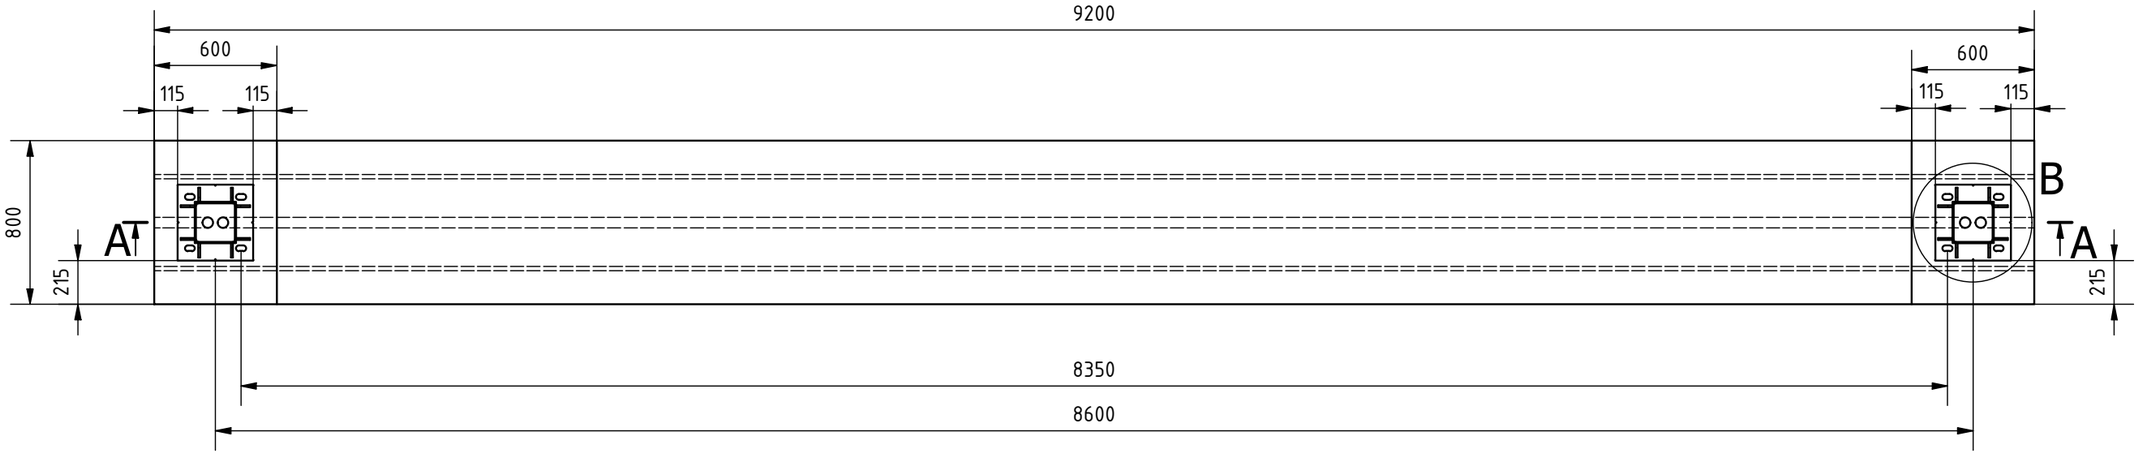


## A-A ( 1 : 30 )

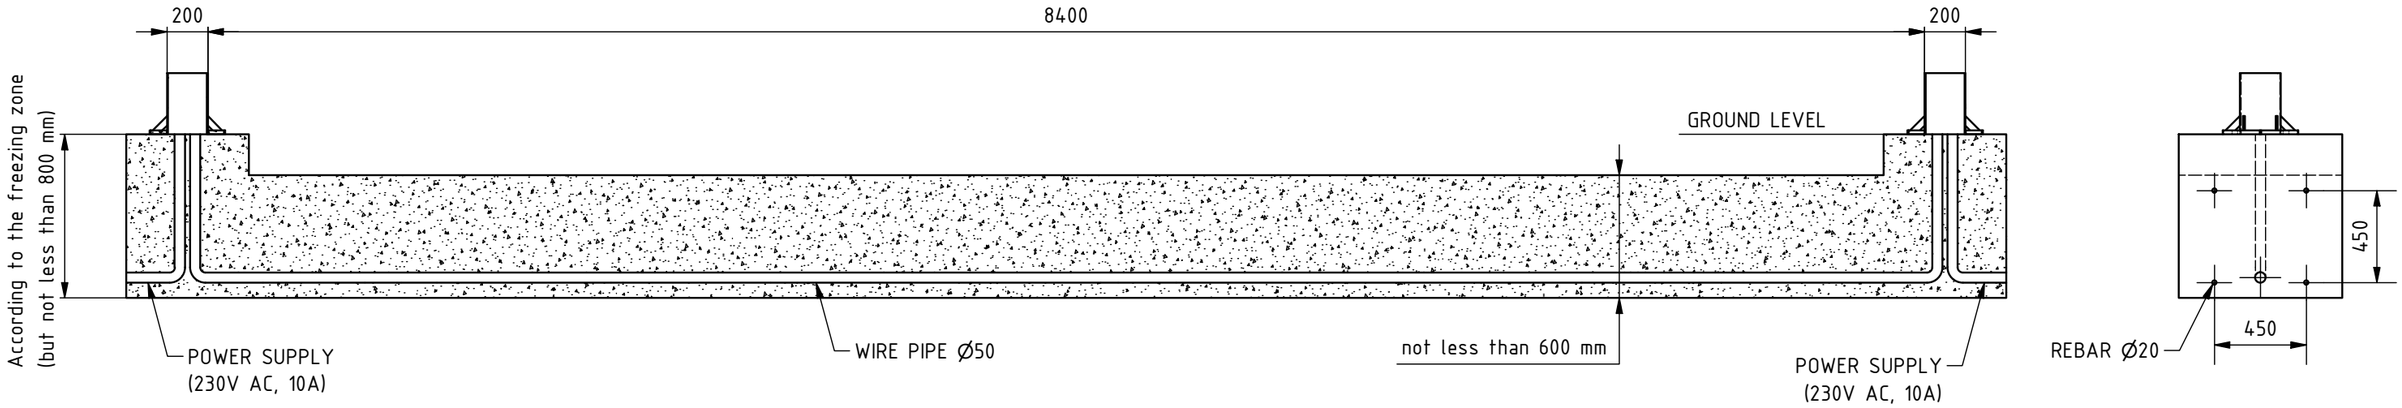


## B ( 1 : 15 )

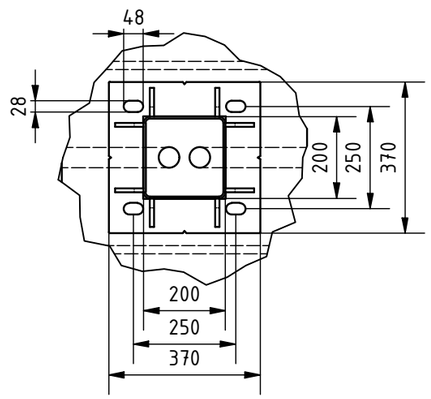


Comments:
1.All dimensions are in mm.
**2.Concrete and steel grade, reinforcement plans, steel lists see separate documents.**
3.The base of the foundations must be frost-resistant.
4.For gate installation use baskets inside cocncrete or use anchors M24 x 400 or longer.Anchors must be over concrete surface between 70 - 100 mm .
5.For gate installation use wire pipes Ø50.
6.Placing gate on or in foundation depending on detailed gate size - to be chosen on installation site.
7.The power supply cable according to the cabinet placment.
8.All dimensions to be checked on site.
9.This is suggested foundation plan. Dimension, reinforcement, anchoring.

| HALSANG | Remarks | | | |
|---|---|---|---|---|
| Designed by<br>M.Pazdan | Scale<br>1 : 30 | Format<br>A3 | Data<br>01.09.2025 | Sheet numer<br>1/1 |
| Edited by<br>K. Rączkowski | Height<br>--- | Width<br>--- | Material<br>--- | Mass<br>--- |
| Number<br>03656.0000 | Drawing<br>Valhalla 2W 8000 Foundation | | | Rev.<br>C |